



DRINKING WATER WORKS PERMIT

Permit Number: 137-201

Issue Number: 2

Pursuant to the *Safe Drinking Water Act, 2002*, S.O. 2002, c. 32, and the regulations made thereunder and subject to the limitations thereof, this drinking water works permit is issued under Part V of the *Safe Drinking Water Act, 2002*, S.O. 2002, c. 32 to:

The Corporation of the Town of Cobourg

**55 King St. W.
Cobourg ON
K9A 2M2**

For the following municipal residential drinking water system:

Cobourg Drinking Water System

This drinking water works permit includes the following:

Schedule	Description
Schedule A	Drinking Water System Description
Schedule B	General
Schedule C	All documents issued as Schedule C to this drinking water works permit which authorize alterations to the drinking water system
Schedule D	Process Flow Diagrams

DATED at TORONTO this 23rd day of June, 2016

Signature

Aziz Ahmed, P.Eng.
Director
Part V, *Safe Drinking Water Act, 2002*

Schedule A: Drinking Water System Description

System Owner	The Corporation of the Town of Cobourg
Permit Number	137-201
Drinking Water System Name	Cobourg Drinking Water System
Schedule A Issue Date	June 23, 2016

1.0 System Description

- 1.1 The following is a summary description of the works comprising the above drinking water system:

Overview

The **Cobourg Drinking Water System** consists of an intake in Lake Ontario, a drinking water treatment plant, two (2) elevated storage tanks with rechlorination, a booster pumping station with rechlorination and approximately 126 kilometers of distribution water mains.

Cobourg Water Treatment Plant

Treatment Plant

Name	Cobourg Water Treatment Plant
Street Address	6 D'Arcy Street
UTM Coordinates	NAD 83: UTM Zone 17: 728485.00 m E., 4870950.00 m N
System Type	Surface Water Source with Chemically Assisted Filtration
Notes	

Surface Water Supply

Intake Crib

Description	Intake structure (hexagonal shape each side 3.5 m) with a centered 1050 mm diameter riser pipe, a screen with 1,525 mm by 200 mm openings
Location	Approximately 856 m south – southwest (SSW) of the Plant Enclosure Building
Notes	A 50 mm diameter chlorine diffuser device located near the screen

Intake Pipe

Description	1050 mm diameter intake pipe
Dimensions	Approximately 856 m from the plant
Notes	A 50 mm diameter chlorine solution supply line inside the raw water intake pipe

Low Lift Works**Influent Wet Well**

Description	Influent wet well connected to the intake pipe complete with one (1) stationary removable Coarse Screen and one (1) Traveling Screen, 1.52 m x 1.88 m x 6.15 m high
Dimensions	
Notes	

Low Lift Well

Description	Low lift well housing the low lift pumps
Dimensions	16.6 m x 6.4 m x 3.95 m side wall depth (SWD)
Notes	A 32 mm chlorine diffuser device located at the inlet of the low lift well on the downstream side of the travelling screen.

Low Lift Pumps

Description	Four (4) low lift vertical turbine pumps
Capacity	One (1) constant speed pump rated at 177 L/s at a TDH of 13.1 m
	One (1) constant speed pump rated at 179 L/s at aTDH of 12.2 m
	Two (2) variable speed pumps each rated at 179 L/s at a TDH of 14.9 m
Notes	All pumps controlled by SCADA and connected to a common 500 mm diameter header discharging to the clarifier

Coagulation/Flocculation

Solids Contact Clarifier

Description	One (1) solids contact clarifier rated at 36,368 m ³ /d
Dimensions	24.5 m diameter and 6.0 m SWD
Notes	Complete with tube settler modules, each 305 mm wide and 610 mm long inclined 60 degrees to the horizontal, one (1) centrally located variable speed submerged coagulator device, one (1) circular fixed weir discharging clarified effluent to the filter-adsorbers and an automatic sludge collection and removal system consisting of a radial sludge collector arm and a central hopper.

Filtration

Rapid Gravity Filter-Adsorber

Description	Two (2) rapid gravity filter-adsorber units
Dimensions	Each unit is 7.92 m x 6.71 m packed with granular activated carbon (GAC) and silica sand media, filter to waste line and air scour assisted backwash
Notes	

Backwash Well

Description	One reservoir with backwash pumps
Dimensions	14.9 m x 12.5 m x 2.85 m SWD
Notes	

Backwash Pumps

Description	Two (2) (duty and standby) centrifugal filter backwash pumps
Capacity	Each pump rated at 433 L/s at a TDH of 9.1 m
Notes	

Instrumentation and Control

SCADA System

Description	A Supervisory Control and Data Acquisition (SCADA) System
Notes	Controls, monitoring and recording

Waste Residual Management

Residual Transfer Cells

Description	Two (2) residual transfer cells accommodating all process flows including filter backwash and clarifier sludge blow-down
Capacity	Usable volume of 410 m ³
Notes	

Transfer Pumps

Description	Two (2) supernatant transfer pumps
Capacity	Two (2) supernatant transfer pumps (duty and standby) each rated at 40 L/s at a TDH of 10.0 m
Notes	Supernatant transfer pumps, installed with one (1) magnetic flow meter and one (1) turbidimeter, discharge to a drainage manhole.

Sludge Transfer Pumps

Description	Two (2) submersible sewage pumps
Capacity	Two (2) submersible sewage pumps each rated at 7.3 L/s at a TDH of 9.4 m
Notes	Sewage pumps pump mixed process wastes from the residual transfer cells to the sewage lift station.

Sewage Lift Station

Description	Two (2) submersible sewage pumps
Capacity	Two (2) submersible sewage pumps each rated at 18.8 L/s at a TDH of 7.0 m
Notes	Sewage pumps pump mixed process wastes to the municipal sewage collection system

Valve Chamber

Description	One (1) 1,800 mm diameter concrete valve chamber
Notes	With 150 mm diameter forcemain to discharge to existing sanitary sewer system on Lakeshore Drive

High Lift Works

High Lift Pumps

Description	Four (4) high lift vertical turbine pumps
Capacity	One (1) constant speed pump rated at 121 L/s at a TDH of 67.0 m
	One (1) constant speed pump rated at 223 L/s at a TDH of 67.0 m
	Two (2) variable speed pumps each rated at 227 L/s at a TDH of 67.0 m
Notes	All individual high lift pump effluents connected to a 600 mm diameter common discharge header

On-Site Storage

Chlorine Contact Tank

Description	One (1) two celled in-ground concrete contact tank to provide 0.5 log inactivation of Giardia Cysts and 2 log inactivation of viruses
Dimensions	Contact volume of 1,840 m ³
Notes	Tank complete with inlet chamber, baffle walls and outlet pipe connecting to the reservoir

Reservoir/Clearwell

Description	One (1) two celled reservoir and one (1) high lift clear well
Dimensions	Reservoir – 27.4 m x 24.4 m x 4.67 m SWD
	High lift clear well – 14.8 m x 4.5 m x 7.55 m SWD
Notes	

Emergency Power

Backup Power Supply

Description	One (1) 320 kW diesel engine standby power generator set located at the high lift pumping station and a 750 kW emergency diesel generator, including a 4260 L fuel storage tank, located outdoors at the treatment site
Notes	

Chemical Addition

Aluminum Sulphate

Description	Coagulant feed system
Feed Point	Low lift pump common discharge header
Equipment	Two (2) (duty and standby) chemical metering pumps each rated at 1.3 L/s at a backpressure of 690 kPa with a 4-20 mA controlled variable speed drive Two (2) 12.9 m ³ usable volume chemical storage tanks
Notes	

Chlorine Gas

Description	Pre and post chlorination
Feed Points	Intake screen in the raw water intake pipe Inlet to low lift well Inlet chamber of the chlorine contact tank Inlet to high lift clear well (not used)
Equipment	Four (4) 227 kg/day chlorinators (one pre-chlorination, one post-chlorination, one plant effluent chlorination and one standby) Two (2) one-ton cylinder weight scales with vacuum regulators, an automatic cylinder switch-over system, gas detector and alarm and 4-20 mA output to SCADA
Notes	

Booster Pumping Station

Ewart Street Pumping Station

Location	9 Ewart Street, Town of Cobourg
UTM Coordinates	
Equipment	Three (3) horizontal centrifugal booster pumps each rated at 76 /s at a TDH of 48.8 m complete with 45 kW variable drive motors A 4.5 m x 3.65 m x 2.2 m deep underground flow meter chamber, complete with a 200 mm diameter magnetic flowmeter A rechlorination system consisting of one (1) 110 L day tank and two (2) chemical metering pumps (duty and standby) each rated at 7.6 L/hr at a backpressure of 500 kPa with feed line connected to a 450 mm diameter forcemain
Standby Power	One (1) 230 kW diesel engine standby power generator and 4260 L fuel storage tank located outdoors at the booster pumping station
Notes	One (1) chlorine residual analyzer monitoring free chlorine residual concentration, connected to the booster pump common discharge header

Elevated Storage Tanks

Zone 1 Elevated System Storage

Location	665 Victoria Street, Town of Cobourg
UTM Coordinates	
Description	Storage as well as rechlorination facility serving Zone 1
Dimensions	1,360 m ³ usable storage volume
Equipment	A rechlorination system consisting of one (1) 60 L storage tank, two (2) chemical metering pumps (duty and standby), each rated at 7.5 L/hr at a backpressure of 1,000 kPa, all installed in a dedicated chemical room, dosing sodium hypochlorite solution at the inlet/outlet watermain on demand
	One (1) chlorine residual analyzer
	One (1) 300 mm diameter bi-directional magnetic flowmeter installed at the inlet/outlet watermain
Notes	

Zone 2 Elevated System Storage

Location	60 Strathy Road, Town of Cobourg
UTM Coordinates	
Description	Storage as well as rechlorination facility serving Zone 2
Dimensions	14 m diameter x 38.55 m concrete shaft with 3,734 m ³ usable storage volume
Equipment	A rechlorination system consisting of one (1) 200 L day tank, two (2) sodium hypochlorite metering pumps (duty and standby), each rated at 5.3 L/hr at a backpressure of 500 kPa,
	One (1) chlorine residual analyzer
Notes	

Watermains

1.2 Watermains within the distribution system comprise:

1.2.1 Watermains that have been set out in each document or file identified in column 1 of Table 1.

Table 1: Watermains	
Column 1 Document or File Name	Column 2 Date
Town of Cobourg Water System	January 28, 2010

1.2.2 Watermains that have been added, modified, replaced or extended further to the provisions of Schedule C of this drinking water works permit on or after the date identified in column 2 of Table 1 for each document or file identified in column 1.

1.2.3 Watermains that have been added, modified, replaced or extended further to an authorization by the Director on or after the date identified in column 2 of Table 1 for each document or file identified in column 1.

Schedule B: General

System Owner	The Corporation of the Town of Cobourg
Permit Number	137-201
Drinking Water System Name	Cobourg Drinking Water System
Schedule B Issue Date	June 23, 2016

1.0 Applicability

- 1.1 In addition to any other requirements, the drinking water system identified above shall be altered and operated in accordance with the conditions of this drinking water works permit and the licence.
- 1.2 The definitions and conditions of the licence shall also apply to this drinking water works permit.

2.0 Alterations to the Drinking Water System

- 2.1 Any document issued by the Director as a Schedule C to this drinking water works permit shall provide authority to alter the drinking water system in accordance, where applicable, with the conditions of this drinking water works permit and the licence.
- 2.2 All Schedule C documents issued by the Director for the drinking water system shall form part of this drinking water works permit.
- 2.3 All parts of the drinking water system in contact with drinking water which are:
- 2.3.1 Added, modified, replaced, extended; or
- 2.3.2 Taken out of service for inspection, repair or other activities that may lead to contamination,
- shall be disinfected before being put into service in accordance with a procedure approved by the Director or in accordance with the applicable provisions of the following documents:
- a) The ministry's Watermain Disinfection Procedure, effective December 23, 2016;
 - b) AWWA C652 – Standard for Disinfection of Water-Storage Facilities;
 - c) AWWA C653 – Standard for Disinfection of Water Treatment Plants; and
 - d) AWWA C654 – Standard for Disinfection of Wells.
- 2.4 The owner shall notify the Director within thirty (30) days of the placing into service or the completion of any addition, modification, replacement or extension of the drinking water system which had been authorized through:
- 2.4.1 Schedule B to this drinking water works permit which would require an alteration of the description of a drinking water system component described in Schedule A of this drinking water works permit;

-
- 2.4.2 Any Schedule C to this drinking water works permit respecting works other than watermains; or
- 2.4.3 Any approval issued prior to the issue date of the first drinking water works permit respecting works other than watermains which were not in service at the time of the issuance of the first drinking water works permit.
- 2.5** For greater certainty, the notification requirements set out in condition 2.4 do not apply to any addition, modification, replacement or extension in respect of the drinking water system which:
- 2.5.1 Is exempt from subsection 31(1) of the SDWA by subsection 9.(2) of O. Reg. 170/03;
- 2.5.2 Constitutes maintenance or repair of the drinking water system; or
- 2.5.3 Is a watermain authorized by condition 3.1 of Schedule B of this drinking water works permit.
- 2.6** The owner shall notify the legal owner of any part of the drinking water system that is prescribed as a municipal drinking water system by section 2 of O. Reg. 172/03 of the requirements of the licence and this drinking water works permit as applicable to the prescribed system.
- 2.7** For greater certainty, any alteration to the drinking water system made in accordance with this drinking water works permit may only be carried out after other legal obligations have been complied with including those arising from the *Environmental Assessment Act*, *Niagara Escarpment Planning and Development Act*, *Oak Ridges Moraine Conservation Act, 2001* and *Greenbelt Act, 2005*.

3.0 Watermain Additions, Modifications, Replacements and Extensions

- 3.1** The drinking water system may be altered by adding, modifying, replacing or extending a watermain within the distribution system subject to the following conditions:
- 3.1.1 The design of the watermain addition, modification, replacement or extension:
- a) Has been prepared by a Professional Engineer;
 - b) Has been designed only to transmit water and has not been designed to treat water;
 - c) Satisfies the design criteria set out in the Ministry of the Environment and Climate Change publication "Watermain Design Criteria for Future Alterations Authorized under a Drinking Water Works Permit – June 2012", as amended from time to time; and
 - d) Is consistent with or otherwise addresses the design objectives contained within the Ministry of the Environment and Climate Change publication "Design Guidelines for Drinking Water Systems, 2008", as amended from time to time.

-
- 3.1.2 The maximum demand for water exerted by consumers who are serviced by the addition, modification, replacement or extension of the watermain will not result in an exceedance of the rated capacity of a treatment subsystem or the maximum flow rate for a treatment subsystem component as specified in the licence, or the creation of adverse conditions within the drinking water system.
 - 3.1.3 The watermain addition, modification, replacement or extension will not adversely affect the distribution system's ability to maintain a minimum pressure of 140 kPa at ground level at all points in the distribution system under maximum day demand plus fire flow conditions.
 - 3.1.4 Secondary disinfection will be provided to water within the added, modified, replaced or extended watermain to meet the requirements of O. Reg. 170/03.
 - 3.1.5 The watermain addition, modification, replacement or extension is wholly located within the municipal boundary over which the owner has jurisdiction.
 - 3.1.6 The owner of the drinking water system consents in writing to the watermain addition, modification, replacement or extension.
 - 3.1.7 A Professional Engineer has verified in writing that the watermain addition, modification, replacement or extension meets the requirements of condition 3.1.1.
 - 3.1.8 The owner of the drinking water system has verified in writing that the watermain addition, modification, replacement or extension meets the requirements of conditions 3.1.2 to 3.1.6.
- 3.2** The authorization for the addition, modification, replacement or extension of a watermain provided for in condition 3.1 does not include the addition, modification, replacement or extension of a watermain that:
- 3.2.1 Passes under or through a body of surface water, unless trenchless construction methods are used;
 - 3.2.2 Has a nominal diameter greater than 750 mm;
 - 3.2.3 Results in the fragmentation of the drinking water system; or
 - 3.2.4 Connects to another drinking water system, unless:
 - a) Prior to construction, the owner of the drinking water system seeking the connection obtains written consent from the owner or owner's delegate of the drinking water system being connected to; and
 - b) The owner of the drinking water system seeking the connection retains a copy of the written consent from the owner or owner's delegate of the drinking water system being connected to as part of the record that is recorded and retained under condition 3.3.

- 3.3** The verifications required in conditions 3.1.7 and 3.1.8 shall be:
- 3.3.1 Recorded on “Form 1 – Record of Watermains Authorized as a Future Alteration”, as published by the Ministry of the Environment and Climate Change, prior to the watermain addition, modification, replacement or extension being placed into service; and
 - 3.3.2 Retained for a period of ten (10) years by the owner.
- 3.4** For greater certainty, the verification requirements set out in condition 3.3 do not apply to any addition, modification, replacement or extension in respect of the drinking water system which:
- 3.4.1 Is exempt from subsection 31(1) of the SDWA by subsection 9.(2) of O. Reg. 170/03; or
 - 3.4.2 Constitutes maintenance or repair of the drinking water system.
- 3.5** The document or file referenced in Column 1 of Table 1 of Schedule A of this drinking water works permit that sets out watermains shall be retained by the owner and shall be updated to include watermain additions, modifications, replacements and extensions within 12 months of the addition, modification, replacement or extension.
- 3.6** The updates required by condition 3.5 shall include watermain location relative to named streets or easements and watermain diameter.

4.0 Minor Modifications to the Drinking Water System

- 4.1** The drinking water system may be altered by adding, modifying or replacing the following components in the drinking water system:
- 4.1.1 Raw water pumps and treatment process pumps in the treatment system;
 - 4.1.2 Coagulant feed systems in the treatment system, including the location and number of dosing points;
 - 4.1.3 Valves;
 - 4.1.4 Instrumentation and controls, including SCADA systems, and software associated with these devices;
 - 4.1.5 Filter media, backwashing equipment and under-drains in the treatment system; or,
 - 4.1.6 Spill containment works.
- 4.2** The drinking water system may be altered by adding, modifying, replacing or removing the following components in the drinking water system:
- 4.2.1 Treated water pumps and associated equipment;
 - 4.2.2 Re-circulation devices within distribution system storage facilities;

-
- 4.2.3 In-line mixing equipment;
 - 4.2.4 Chemical metering pumps and chemical handling pumps;
 - 4.2.5 Chemical storage tanks (excluding fuel storage tanks) and associated equipment; or,
 - 4.2.6 Measuring and monitoring devices that are not required by regulation, by a condition in the Drinking Water Works Permit, or by a condition otherwise imposed by the Ministry of the Environment and Climate Change.
- 4.3** The drinking water system may be altered by replacing the following:
- 4.3.1 Raw water piping, treatment process piping or treated water piping within the treatment subsystem;
 - 4.3.2 Fuel storage tanks and spill containment works, and associated equipment; or
 - 4.3.3 Coagulants and pH adjustment chemicals, where the replacement chemicals perform the same function;
 - a) Prior to making any alteration to the drinking water system under condition 4.3.3, the owner shall undertake a review of the impacts that the alteration might have on corrosion control or other treatment processes; and
 - b) The owner shall notify the Director in writing within thirty (30) days of any alteration made under condition 4.3.3 and shall provide the Director with a copy of the review.
- 4.4** Any alteration of the drinking water system made under conditions 4.1, 4.2 or 4.3 shall not result in:
- 4.4.1 An exceedance of a treatment subsystem rated capacity or a treatment subsystem component maximum flow rate as specified in the licence;
 - 4.4.2 The bypassing of any unit process within a treatment subsystem;
 - 4.4.3 A deterioration in the quality of drinking water provided to consumers;
 - 4.4.4 A reduction in the reliability or redundancy of any component of the drinking water system;
 - 4.4.5 A negative impact on the ability to undertake compliance and other monitoring necessary for the operation of the drinking water system; or
 - 4.4.6 An adverse effect on the environment.
- 4.5** The owner shall verify in writing that any addition, modification, replacement or removal of drinking water system components in accordance with conditions 4.1, 4.2 or 4.3 has met the requirements of the conditions listed in condition 4.4.

- 4.6** The verifications and documentation required in condition 4.5 shall be:
- 4.6.1 Recorded on “Form 2 – Record of Minor Modifications or Replacements to the Drinking Water System”, as published by the Ministry of the Environment and Climate Change, prior to the modified or replaced components being placed into service; and
 - 4.6.2 Retained for a period of ten (10) years by the owner.
- 4.7** For greater certainty, the verification requirements set out in conditions 4.5 and 4.6 do not apply to any addition, modification, replacement or removal in respect of the drinking water system which:
- 4.7.1 Is exempt from subsection 31(1) of the SDWA by subsection 9.(2) of O. Reg. 170/03; or
 - 4.7.2 Constitutes maintenance or repair of the drinking water system.
- 4.8** The owner shall update any drawings maintained for the drinking water system to reflect the modification or replacement of the works, where applicable.

5.0 Equipment with Emissions to the Air

- 5.1** The drinking water system may be altered by adding, modifying or replacing any of the following drinking water system components that may discharge or alter the rate or manner of a discharge of a compound of concern to the atmosphere:
- 5.1.1 Any equipment, apparatus, mechanism or thing that is used for the transfer of outdoor air into a building or structure that is not a cooling tower;
 - 5.1.2 Any equipment, apparatus, mechanism or thing that is used for the transfer of indoor air out of a space used for the production, processing, repair, maintenance or storage of goods or materials, including chemical storage;
 - 5.1.3 Laboratory fume hoods used for drinking water testing, quality control and quality assurance purposes;
 - 5.1.4 Low temperature handling of compounds with a vapor pressure of less than 1 kilopascal;
 - 5.1.5 Maintenance welding stations;
 - 5.1.6 Minor painting operations used for maintenance purposes;
 - 5.1.7 Parts washers for maintenance shops;
 - 5.1.8 Emergency chlorine and ammonia gas scrubbers and absorbers;
 - 5.1.9 Venting for activated carbon units for drinking water taste and odour control;
 - 5.1.10 Venting for a stripping unit for methane removal from a groundwater supply;
 - 5.1.11 Venting for an ozone treatment unit;

-
- 5.1.12 Natural gas or propane fired boilers, water heaters, space heaters and make-up air units with a total facility-wide heat input rating of less than 20 million kilojoules per hour, and with an individual fuel energy input of less than or equal to 10.5 gigajoules per hour; or
- 5.1.13 Emergency generators that fire No. 2 fuel oil (diesel fuel) with a sulphur content of 0.5 per cent or less measured by weight, natural gas, propane, gasoline or biofuel, and that are used for emergency duty only with periodic testing.
- 5.2** The owner shall not add, modify or replace a drinking water system component set out in condition 5.1 for an activity that is not directly related to the treatment and/or distribution of drinking water.
- 5.3** The emergency generators identified in condition 5.1.13 shall not be used for non-emergency purposes including the generation of electricity for sale or for peak shaving purposes.
- 5.4** The owner shall prepare an emission summary table for nitrogen oxide emissions only, for each addition, modification or replacement of emergency generators identified in condition 5.1.13.

Performance Limits

- 5.5** The owner shall ensure that a drinking water system component identified in conditions 5.1.1 to 5.1.13 is operated at all times to comply with the following limits:
- 5.5.1 For equipment other than emergency generators, the maximum concentration of any compound of concern at a point of impingement shall not exceed the corresponding point of impingement limit;
- 5.5.2 For emergency generators, the maximum concentration of nitrogen oxides at sensitive populations shall not exceed the applicable point of impingement limit, and at non-sensitive populations shall not exceed the Ministry of the Environment and Climate Change half-hourly screening level of 1880 ug/m³ as amended; and
- 5.5.3 The noise emissions comply at all times with the limits set out in publication NPC-300, as applicable.
- 5.6** The owner shall verify in writing that any addition, modification or replacement of works in accordance with condition 5.1 has met the requirements of the conditions listed in condition 5.5.
- 5.7** The owner shall document how compliance with the performance limits outlined in condition 5.5.3 is being achieved, through noise abatement equipment and/or operational procedures.
- 5.8** The verifications and documentation required in conditions 5.6 and 5.7 shall be:
- 5.8.1 Recorded on "Form 3 – Record of Addition, Modification or Replacement of Equipment Discharging a Contaminant of Concern to the Atmosphere", as published by the Ministry of the Environment and Climate Change, prior to the additional, modified or replacement equipment being placed into service; and

5.8.2 Retained for a period of ten (10) years by the owner.

5.9 For greater certainty, the verification and documentation requirements set out in conditions 5.6 and 5.8 do not apply to any addition, modification or replacement in respect of the drinking water system which:

5.9.1 Is exempt from subsection 31(1) of the SDWA by subsection 9.(2) of O. Reg. 170/03; or

5.9.2 Constitutes maintenance or repair of the drinking water system.

5.10 The owner shall update any drawings maintained for the works to reflect the addition, modification or replacement of the works, where applicable.

6.0 Previously Approved Works

6.1 The owner may add, modify, replace or extend, and operate part of a municipal drinking water system if:

6.1.1 An approval was issued after January 1, 2004 under section 36 of the SDWA in respect of the addition, modification, replacement or extension and operation of that part of the municipal drinking water system;

6.1.2 The approval expired by virtue of subsection 36(4) of the SDWA; and

6.1.3 The addition, modification, replacement or extension commenced within five years of the date that activity was approved by the expired approval.

7.0 System-Specific Conditions

7.1 Not Applicable

8.0 Source Protection


8.1 Not Applicable

Schedule D: Process Flow Diagrams

System Owner	The Corporation of the Town of Cobourg
Permit Number	137-201
Drinking Water System Name	Cobourg Drinking Water System
Schedule D Issue Date	June 23, 2016

1.0 Process Flow Diagrams

Cobourg Water Treatment Plant

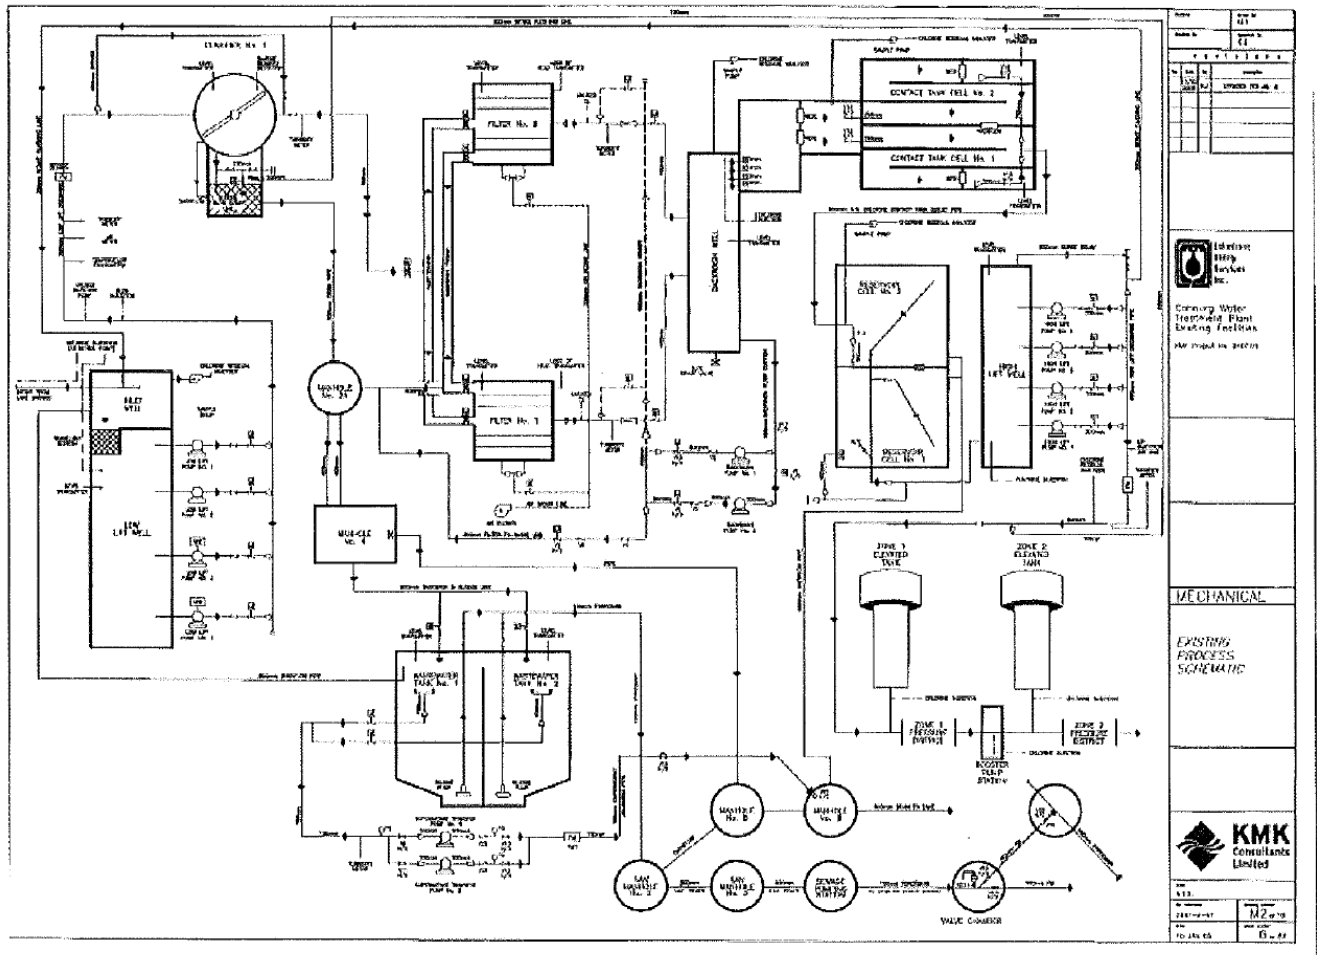

[Source: Cobourg Water System Drinking Water Quality Management System Operation Plan, Revision 20, November 11, 2015]